

Public Water System Annual Report

-2019-

Name of the Public Water System: **South Central District Water Co-op**

Name of the Legal Owner: **South Central District Water Co-operative Inc.**

Contact Person: **Brent Checkley, Board Chairperson**

Phone: **(204) 825-7000**

Emergency number: **(204) 245-9101**

Name of Lead Operator: **Mr. Keith Klassen**

Name of Back-up Operator: **Mr. Don Deamal**

Phone during business hours: **(204) 825-2115**



Date Prepared: March 2020

Brent Checkley
Board Chairperson
South Central District Water Co-op Inc.

Table of Contents

1.	Introduction:	3
2.	Description of the Water System	3
	<i>2.1. Water Supply Source</i>	3
	<i>2.2 Water Treatment Process</i>	3
	<i>2.3 Classification and Certification</i>	4
3.	List of Water Quality Standards	4
4.	Water System Incidents and Corrective Actions	5
5.	Drinking Water Safety Orders, Warnings, and Charges	5
6.	Major Expenses Incurred	5
7.	Future System Expansion	5
	<i>Appendix A</i>	6
	<i>Appendix B</i>	14



1. Introduction:

The 2019 South Central District Water Co-op Annual Report summarizes the water utility's ability to provide safe potable water and comply with provincial regulations.

2. Description of the Water System

The South Central District Water Co-op provides potable drinking water to a population of approximately 1800 residents. No corrective actions or emergency reporting was required. Full results have been attached in Appendix A.

The South Central District Water Co-op water system consists of two wells, raw water supply pipeline, water treatment plant (WTP), and a treated water transmission pipeline to the water storage reservoir in the town of Manitou (located in the R.M. of Pembina).

In 2019, one rural connection was made off the transmission line between Pilot Mound and Manitou, The Windy Bay Colony.

2.1. *Water Supply Source*

The South Central District Water Co-op receives its raw water supply from two groundwater wells, located approximately 15 km west of the WTP on SE 30-3-12W. One well can supply the system when one treatment skid is operating, and the second well supplements the supply when both treatment skids are operating.

The system provides treated water to the towns of Pilot Mound and Manitou, and some rural connections along the transmission pipeline.

2.2 *Water Treatment Process*

The treatment system is comprised of: two parallel RO membrane filtration skids; manganese greensand bypass filter with UV disinfection. The treatment system ensures that the water meets the *Guidelines for Canadian Drinking Water Quality* and the provincial *Drinking Water Safety Act*.

The water treatment process is designed to reduce iron and manganese concentrations, and reduce hardness to an acceptable level. Iron and manganese are metals that cause laundry and plumbing fixture staining problems, and can build up in the distribution pipes and cause reduced flow. Calcium carbonate (CaCO_3) causes hardness in water which diminishes the ability of the water to react with soap and form lather. Hardness also forms scale deposits in kettles and hot water tanks which can reduce the life expectancy of these appliances. Since membranes are capable of removing most of the hardness ions, a percentage of the raw water bypasses the membrane system and is filtered through a manganese greensand

pressure filter. Water passing through the pressure filter continues through the UV process and is then blended with membrane permeate to produce the desired finished water hardness.

Potassium Permanganate is injected prior to the green sand filter to oxidize iron and manganese. Iron is precipitated and filtered out, while manganese is removed mostly by adsorption within the green sand layer of the pressure filter.

Antiscalant is injected in the membrane raw water supply to minimize RO membrane fouling by sequestering dissolved metals and minerals during the treatment and concentrate phases. Since membranes remove dissolved minerals, water stabilization through pH adjustment is required to produce a non-corrosive treated water supply.

Chlorine for disinfection is added to maintain an adequate free chlorine residual concentration in the reservoir. Plant operators are required to test the water several times throughout the day at various points within the WTP to ensure break-point chlorination required for water safety is being achieved.

Treated water is stored in a 150,000 Imperial gallon, three-cell reinforced concrete reservoir. The reservoir is equipped with ultrasonic level control and monitored with a SCADA system.

2.3 Classification and Certification

The South Central District Treatment Plant is a Class 2 water treatment facility with a Class 1 water distribution system. Facility classifications are used to determine certification requirements for the water system operators. The full-time operator is certified Class 2 and relief operator is working towards their Class 2 certification. Both operators are also certified Class 1 water distribution operators.

3. List of Water Quality Standards

The Province of Manitoba has adopted a number of water quality standards from the Health Canada *Guidelines for Canadian Drinking Water Quality*. The health-based parameters express the maximum acceptable concentrations for drinking water. Concentration values in excess of the guidelines constitute a health-related issue and require corrective actions. All health based parameters were within the limits in 2019 for the South Central District Water System.

Public water systems are required to monitor chlorine levels and undertake regular bacterial testing. The South Central District system met all requirements for water quality standards and monitoring requirements in 2019 and is fulfilling the requirements of their Operating Licence.

4. Water System Incidents and Corrective Actions

There were no major water system incidents in 2019. There were no corrective actions or emergency reporting required.

5. Drinking Water Safety Orders, Warnings, and Charges

There were no Drinking Water Safety Orders or warnings issued, nor were any charges laid on the system.

6. Major Expenses Incurred

There were no major expenses for the South Central District Water System in 2019.

Appendix A

Results of Water Chemistry, Bacterial and Chlorine Residual Analysis



Chlorine Residual and TC/EC Analyses

Collection Date	Sample Identification	TC	EC	CL2 Free	CL2 Total
2019-01-08	SOUTH CENTRAL REGIONAL - MANITOU INCOMING	0	0	0.63	0.69
2019-01-08	SOUTH CENTRAL REGIONAL - MANITOU OUTGOING	0	0	0.88	0.95
2019-01-09	SOUTH CENTRAL REGIONAL - PILOT MOUND RAW	0	0	na	na
2019-01-09	SOUTH CENTRAL REGIONAL - PILOT MOUND TREATED	0	0	0.72	0.81
2019-01-21	SOUTH CENTRAL REGIONAL - MANITOU INCOMING	0	0	0.55	0.68
2019-01-21	SOUTH CENTRAL REGIONAL - MANITOU OUTGOING	0	0	1.10	1.18
2019-01-22	SOUTH CENTRAL REGIONAL - PILOT MOUND RAW	0	0	na	na
2019-01-22	SOUTH CENTRAL REGIONAL - PILOT MOUND TREATED	0	0	0.72	0.83
2019-02-05	SOUTH CENTRAL REGIONAL - MANITOU INCOMING	0	0	0.67	0.71
2019-02-05	SOUTH CENTRAL REGIONAL - MANITOU OUTGOING	0	0	0.92	0.99
2019-02-05	SOUTH CENTRAL REGIONAL - PILOT MOUND RAW	0	0	na	na
2019-02-05	SOUTH CENTRAL REGIONAL - PILOT MOUND TREATED	0	0	0.73	0.84
2019-02-19	SOUTH CENTRAL REGIONAL - MANITOU INCOMING	0	0	0.61	0.71
2019-02-19	SOUTH CENTRAL REGIONAL - MANITOU OUTGOING	0	0	0.94	1.08
2019-02-19	SOUTH CENTRAL REGIONAL - PILOT MOUND RAW	0	0	na	na
2019-02-19	SOUTH CENTRAL REGIONAL - PILOT MOUND TREATED	0	0	0.73	0.82
2019-03-11	SOUTH CENTRAL REGIONAL - MANITOU INCOMING	0	0	0.70	0.75
2019-03-11	SOUTH CENTRAL REGIONAL - MANITOU OUTGOING	0	0	0.93	0.86
2019-03-05	SOUTH CENTRAL REGIONAL - PILOT MOUND RAW	0	0	na	na
2019-03-05	SOUTH CENTRAL REGIONAL - PILOT MOUND TREATED	0	0	0.74	0.86
2019-03-25	SOUTH CENTRAL REGIONAL - MANITOU INCOMING	0	0	0.61	0.69
2019-03-25	SOUTH CENTRAL REGIONAL - MANITOU OUTGOING	0	0	0.90	0.98
2019-03-19	SOUTH CENTRAL REGIONAL - PILOT MOUND RAW	0	0	na	na
2019-03-19	SOUTH CENTRAL REGIONAL - PILOT MOUND TREATED	0	0	0.72	0.84
2019-04-08	SOUTH CENTRAL REGIONAL - MANITOU INCOMING	0	0	0.66	0.68
2019-04-08	SOUTH CENTRAL REGIONAL - MANITOU OUTGOING	0	0	0.86	0.89
2019-04-02	SOUTH CENTRAL REGIONAL - PILOT MOUND RAW	0	0	na	na
2019-04-02	SOUTH CENTRAL REGIONAL - PILOT MOUND TREATED	0	0	0.70	0.82
2019-04-23	SOUTH CENTRAL REGIONAL - MANITOU INCOMING	0	0	0.69	0.73
2019-04-23	SOUTH CENTRAL REGIONAL - MANITOU OUTGOING	0	0	0.84	0.94
2019-04-19	SOUTH CENTRAL REGIONAL - PILOT MOUND RAW	0	0	na	na
2019-04-19	SOUTH CENTRAL REGIONAL - PILOT MOUND TREATED	0	0	0.72	0.85
2019-05-06	SOUTH CENTRAL REGIONAL - MANITOU INCOMING	0	0	0.63	0.72
2019-05-06	SOUTH CENTRAL REGIONAL - MANITOU OUTGOING	0	0	0.65	0.71
2019-04-30	SOUTH CENTRAL REGIONAL - PILOT MOUND RAW	0	0	na	na
2019-04-30	SOUTH CENTRAL REGIONAL - PILOT MOUND TREATED	0	0	0.70	0.82

Chlorine Residual and TC/EC Analyses (continued)

Collection Date	Sample Identification	TC	EC	CL2 Free	CL2 Total
2019-05-21	SOUTH CENTRAL REGIONAL - MANITOU INCOMING	0	0	0.66	0.68
2019-05-21	SOUTH CENTRAL REGIONAL - MANITOU OUTGOING	0	0	0.75	0.80
2019-05-14	SOUTH CENTRAL REGIONAL - PILOT MOUND RAW	0	0	na	na
2019-05-14	SOUTH CENTRAL REGIONAL - PILOT MOUND TREATED	0	0	0.72	0.87
2019-06-03	SOUTH CENTRAL REGIONAL - MANITOU INCOMING	0	0	0.70	0.75
2019-06-03	SOUTH CENTRAL REGIONAL - MANITOU OUTGOING	0	0	0.85	0.88
2019-05-28	SOUTH CENTRAL REGIONAL - PILOT MOUND RAW	0	0	na	na
2019-05-28	SOUTH CENTRAL REGIONAL - PILOT MOUND TREATED	0	0	0.75	0.86
2019-06-17	SOUTH CENTRAL REGIONAL - MANITOU INCOMING	0	0	0.66	0.73
2019-06-17	SOUTH CENTRAL REGIONAL - MANITOU OUTGOING	0	0	0.91	0.99
2019-06-11	SOUTH CENTRAL REGIONAL - PILOT MOUND RAW	0	0	na	na
2019-06-11	SOUTH CENTRAL REGIONAL - PILOT MOUND TREATED	0	0	0.70	0.81
2019-07-02	SOUTH CENTRAL REGIONAL - MANITOU INCOMING	0	0	0.72	0.74
2019-07-02	SOUTH CENTRAL REGIONAL - MANITOU OUTGOING	0	0	0.73	0.80
2019-06-25	SOUTH CENTRAL REGIONAL - PILOT MOUND RAW	0	0	na	na
2019-06-25	SOUTH CENTRAL REGIONAL - PILOT MOUND TREATED	0	0	0.72	0.84
2019-07-15	SOUTH CENTRAL REGIONAL - MANITOU INCOMING	0	0	0.64	0.69
2019-07-15	SOUTH CENTRAL REGIONAL - MANITOU OUTGOING	0	0	0.56	0.64
2019-07-09	SOUTH CENTRAL REGIONAL - PILOT MOUND RAW	0	0	na	na
2019-07-09	SOUTH CENTRAL REGIONAL - PILOT MOUND TREATED	0	0	0.69	0.81
2019-07-22	SOUTH CENTRAL REGIONAL - MANITOU INCOMING	0	0	0.69	0.72
2019-07-22	SOUTH CENTRAL REGIONAL - MANITOU OUTGOING	0	0	0.68	0.70
2019-07-23	SOUTH CENTRAL REGIONAL - PILOT MOUND RAW	0	0	na	na
2019-07-23	SOUTH CENTRAL REGIONAL - PILOT MOUND TREATED	0	0	0.71	0.81
2019-08-06	SOUTH CENTRAL REGIONAL - MANITOU INCOMING	0	0	0.72	0.73
2019-08-06	SOUTH CENTRAL REGIONAL - MANITOU OUTGOING	0	0	1.32	1.34
2019-08-06	SOUTH CENTRAL REGIONAL - PILOT MOUND RAW	0	0	na	na
2019-08-06	SOUTH CENTRAL REGIONAL - PILOT MOUND TREATED	0	0	0.69	0.80
2019-08-19	SOUTH CENTRAL REGIONAL - MANITOU INCOMING	0	0	0.64	0.70
2019-08-19	SOUTH CENTRAL REGIONAL - MANITOU OUTGOING	0	0	1.35	1.46
2019-08-20	SOUTH CENTRAL REGIONAL - PILOT MOUND RAW	0	0	na	Nn
2019-08-20	SOUTH CENTRAL REGIONAL - PILOT MOUND TREATED	0	0	0.74	0.84
2019-09-03	SOUTH CENTRAL REGIONAL - MANITOU INCOMING	0	0	0.60	0.69
2019-09-03	SOUTH CENTRAL REGIONAL - MANITOU OUTGOING	0	0	1.11	1.22
2019-09-09	SOUTH CENTRAL REGIONAL - PILOT MOUND RAW	0	0	na	na
2019-09-09	SOUTH CENTRAL REGIONAL - PILOT MOUND TREATED	0	0	0.72	0.82

Chlorine Residual and TC/EC Analyses (continued)

Collection Date	Sample Identification	TC	EC	CL2 Free	CL2 Total
2019-09-16	SOUTH CENTRAL REGIONAL - MANITOU INCOMING	0	0	0.68	0.71
2019-09-16	SOUTH CENTRAL REGIONAL - MANITOU OUTGOING	0	0	1.14	1.19
2019-09-18	SOUTH CENTRAL REGIONAL - PILOT MOUND RAW	0	0	na	na
2019-09-18	SOUTH CENTRAL REGIONAL - PILOT MOUND TREATED	0	0	0.72	0.83
2019-09-30	SOUTH CENTRAL REGIONAL - MANITOU INCOMING	0	0	0.59	0.66
2019-09-30	SOUTH CENTRAL REGIONAL - MANITOU OUTGOING	0	0	1.04	1.07
2019-10-01	SOUTH CENTRAL REGIONAL - PILOT MOUND RAW	0	0	na	na
2019-10-01	SOUTH CENTRAL REGIONAL - PILOT MOUND TREATED	0	0	0.72	0.85
2019-10-15	SOUTH CENTRAL REGIONAL - MANITOU INCOMING	0	0	0.65	0.69
2019-10-15	SOUTH CENTRAL REGIONAL - MANITOU OUTGOING	0	0	0.92	1.02
2019-10-15	SOUTH CENTRAL REGIONAL - PILOT MOUND RAW	0	0	na	na
2019-10-15	SOUTH CENTRAL REGIONAL - PILOT MOUND TREATED	0	0	0.71	0.79
2019-10-28	SOUTH CENTRAL REGIONAL - MANITOU INCOMING	0	0	0.62	0.70
2019-10-28	SOUTH CENTRAL REGIONAL - MANITOU OUTGOING	0	0	0.92	1.07
2019-10-29	SOUTH CENTRAL REGIONAL - PILOT MOUND RAW	0	0	na	na
2019-10-29	SOUTH CENTRAL REGIONAL - PILOT MOUND TREATED	0	0	0.74	0.83
2019-11-12	SOUTH CENTRAL REGIONAL - MANITOU INCOMING	0	0	0.59	0.71
2019-11-12	SOUTH CENTRAL REGIONAL - MANITOU OUTGOING	0	0	1.27	1.33
2019-11-12	SOUTH CENTRAL REGIONAL - PILOT MOUND RAW	0	0	na	na
2019-11-12	SOUTH CENTRAL REGIONAL - PILOT MOUND TREATED	0	0	0.72	0.82
2019-11-26	SOUTH CENTRAL REGIONAL - MANITOU INCOMING	0	0	0.69	0.70
2019-11-26	SOUTH CENTRAL REGIONAL - MANITOU OUTGOING	0	0	1.14	1.23
2019-11-26	SOUTH CENTRAL REGIONAL - PILOT MOUND RAW	0	0	na	na
2019-11-26	SOUTH CENTRAL REGIONAL - PILOT MOUND TREATED	0	0	0.70	0.83
2019-12-09	SOUTH CENTRAL REGIONAL - MANITOU INCOMING	0	0	0.66	0.72
2019-12-09	SOUTH CENTRAL REGIONAL - MANITOU OUTGOING	0	0	1.23	1.30
2019-12-10	SOUTH CENTRAL REGIONAL - PILOT MOUND RAW	0	0	na	na
2019-12-10	SOUTH CENTRAL REGIONAL - PILOT MOUND TREATED	0	0	0.80	0.90
2019-12-16	SOUTH CENTRAL REGIONAL - MANITOU INCOMING	0	0	0.64	0.72
2019-12-16	SOUTH CENTRAL REGIONAL - MANITOU OUTGOING	0	0	1.04	1.16
2019-12-23	SOUTH CENTRAL REGIONAL - PILOT MOUND RAW	0	0	na	na
2019-12-23	SOUTH CENTRAL REGIONAL - PILOT MOUND TREATED	0	0	0.75	0.87

Notes:

CL2: Reported in units of mg/L

TC/EC: Reported in units of MPN/100 mL

NDSF: No Data - Sample Received Frozen

Water Chemistry



Municipality of Louise - South Central
Regional-PWS
ATTN: SOUTH CENTRAL DISTRICT WATER
CO-OP

Box 310
Crystal City MB R0K 0N0

Date Received: 04-NOV-19
Report Date: 19-NOV-19 07:00 (MT)
Version: FINAL

Client Phone: 204-873-2591

Certificate of Analysis

Lab Work Order #: L2376605
Project P.O. #: NOT SUBMITTED
Job Reference: SOUTH CENTRAL REGIONAL - PWS 203.75
C of C Numbers:
Legal Site Desc: 59047

Hua Wo
Chemistry Laboratory Manager

[This report shall not be reproduced except in full without the written authority of the Laboratory.]

ADDRESS: 1329 Niakwa Road East, Unit 12, Winnipeg, MB R2J 3T4 Canada | Phone: +1 204 255 9720 | Fax: +1 204 255 9721
ALS CANADA LTD Part of the ALS Group An ALS Limited Company

Environmental

www.alsglobal.com

RIGHT SOLUTIONS RIGHT PARTNER

Water Chemistry (continued)



ANALYTICAL REPORT

L2376605 CONTD....
PAGE 2 of 7
19-NOV-19 07:00 (MT)

Physical Tests (WATER)

		ALS ID		L2376605-1	L2376605-2
		Sampled Date		31-OCT-19	31-OCT-19
		Sampled Time		15:00	15:15
		Sample ID			
		Guide Limit #1		SOUTH CENTRAL REGIONAL 1 - RAW	SOUTH CENTRAL REGIONAL 2 - TREATED
Analyte	Unit	Guide Limit #1	Guide Limit #2		
Colour, True	CU	15	-	<5.0	<5.0
Conductivity	umhos/cm	-	-	516	197
Hardness (as CaCO ₃)	mg/L	-	-	272 ^{HTC}	75.5 ^{HTC}
Langelier Index (4 C)	No Unit	-	-	0.22	-0.55
Langelier Index (60 C)	No Unit	-	-	0.99	0.22
pH	pH units	7.00-10.5	-	7.65	7.79
Total Dissolved Solids	mg/L	500	-	360	133
Transmittance, UV (254 nm)	%T/cm	-	-	93.5	97.1
Turbidity	NTU	-	-	0.83	<0.10

Federal Guidelines for Canadian Drinking Water Quality (MAR, 2019)

#1: GCDWQ - Aesthetic Objective/Other Value

#2: GCDWQ - Maximum Acceptable Concentrations (MACs)

Anions and Nutrients (WATER)

		ALS ID		L2376605-1	L2376605-2
		Sampled Date		31-OCT-19	31-OCT-19
		Sampled Time		15:00	15:15
		Sample ID			
		Guide Limit #1		SOUTH CENTRAL REGIONAL 1 - RAW	SOUTH CENTRAL REGIONAL 2 - TREATED
Analyte	Unit	Guide Limit #1	Guide Limit #2		
Alkalinity, Total (as CaCO ₃)	mg/L	-	-	245	90.4
Ammonia, Total (as N)	mg/L	-	-	0.115	0.016
Bicarbonate (HCO ₃)	mg/L	-	-	299	110
Bromide (Br)	mg/L	-	-	0.020	<0.10 ^{DLM}
Carbonate (CO ₃)	mg/L	-	-	<0.60	<0.60
Chloride (Cl)	mg/L	250	-	3.33	2.7
Fluoride (F)	mg/L	-	1.5	0.135	<0.20 ^{DLM}
Hydroxide (OH)	mg/L	-	-	<0.34	<0.34
Nitrate (as N)	mg/L	-	10	<0.0050	<0.050 ^{DLM}
Nitrite (as N)	mg/L	-	1	<0.0010	<0.010 ^{DLM}
Sulfate (SO ₄)	mg/L	500	-	47.7	11.8

Federal Guidelines for Canadian Drinking Water Quality (MAR, 2019)

#1: GCDWQ - Aesthetic Objective/Other Value

#2: GCDWQ - Maximum Acceptable Concentrations (MACs)

Organic / Inorganic Carbon (WATER)

		ALS ID		L2376605-1	L2376605-2
		Sampled Date		31-OCT-19	31-OCT-19
		Sampled Time		15:00	15:15
		Sample ID			
		Guide Limit #1		SOUTH CENTRAL REGIONAL 1 - RAW	SOUTH CENTRAL REGIONAL 2 - TREATED
Analyte	Unit	Guide Limit #1	Guide Limit #2		
Dissolved Organic Carbon	mg/L	-	-	1.30	0.51
Total Organic Carbon	mg/L	-	-	1.18	<0.50

Federal Guidelines for Canadian Drinking Water Quality (MAR, 2019)

#1: GCDWQ - Aesthetic Objective/Other Value

#2: GCDWQ - Maximum Acceptable Concentrations (MACs)

Detection Limit for result exceeds Guide Limit. Assessment against Guide Limit cannot be made.
 Analytical result for this parameter exceeds Guide Limit listed on this report.

* Please refer to the Reference Information section for an explanation of any qualifiers noted.

Water Chemistry (continued)



ANALYTICAL REPORT

L2376605 CONTD....
PAGE 3 of 7
19-NOV-19 07:00 (MT)

Total Metals (WATER)

Analyte	Unit	ALS ID		L2376605-1	L2376605-2	L2376605-3
		Guide Limit #1	Guide Limit #2	Sampled Date Sampled Time Sample ID	Sampled Date Sampled Time Sample ID	Sampled Date Sampled Time Sample ID
				31-OCT-19 15:00 SOUTH CENTRAL REGIONAL 1 - RAW	31-OCT-19 15:15 SOUTH CENTRAL REGIONAL 2 - TREATED	31-OCT-19 14:30 SOUTH CENTRAL REGIONAL 3 - DISTRIBUTION
Aluminum (Al)-Total	mg/L	0.1	-	<0.0030	<0.0030	0.0118
Antimony (Sb)-Total	mg/L	-	0.006	<0.00010	<0.00010	<0.00010
Arsenic (As)-Total	mg/L	-	0.01	0.00156	0.00032	0.00034
Barium (Ba)-Total	mg/L	-	1	0.0937	0.0209	0.0183
Beryllium (Be)-Total	mg/L	-	-	<0.00010	<0.00010	<0.00010
Bismuth (Bi)-Total	mg/L	-	-	<0.000050	<0.000050	<0.000050
Boron (B)-Total	mg/L	-	5	0.049	0.039	0.040
Cadmium (Cd)-Total	mg/L	-	0.005	<0.000050	<0.000050	<0.000050
Calcium (Ca)-Total	mg/L	-	-	74.3	20.3	22.1
Cesium (Cs)-Total	mg/L	-	-	<0.000010	<0.000010	<0.000010
Chromium (Cr)-Total	mg/L	-	0.05	<0.00010	<0.00010	<0.00010
Cobalt (Co)-Total	mg/L	-	-	0.00014	<0.00010	<0.00010
Copper (Cu)-Total	mg/L	1	2	<0.00050	0.00442	0.0378
Iron (Fe)-Total	mg/L	0.3	-	0.180	<0.010	<0.010
Lead (Pb)-Total	mg/L	-	0.005	<0.000050	0.000057	0.000206
Lithium (Li)-Total	mg/L	-	-	0.0201	0.0069	0.0072
Magnesium (Mg)-Total	mg/L	-	-	21.1	6.04	5.75
Manganese (Mn)-Total	mg/L	0.02	0.12	0.423	0.00172	0.00186
Molybdenum (Mo)-Total	mg/L	-	-	0.00111	0.000199	0.000239
Nickel (Ni)-Total	mg/L	-	-	<0.00050	<0.00050	<0.00050
Phosphorus (P)-Total	mg/L	-	-	0.040	<0.030	0.593
Potassium (K)-Total	mg/L	-	-	2.70	1.02	1.06
Rubidium (Rb)-Total	mg/L	-	-	0.00142	0.00050	0.00056
Selenium (Se)-Total	mg/L	-	0.05	<0.000050	<0.000050	<0.000050
Silicon (Si)-Total	mg/L	-	-	13.2	4.14	4.17
Silver (Ag)-Total	mg/L	-	-	<0.000010	<0.000010	<0.000010
Sodium (Na)-Total	mg/L	200	-	12.5	14.2	14.8
Strontium (Sr)-Total	mg/L	-	7	0.199	0.0559	0.0608
Sulfur (S)-Total	mg/L	-	-	16.5	4.26	4.68
Tellurium (Te)-Total	mg/L	-	-	<0.00020	<0.00020	<0.00020
Thallium (Tl)-Total	mg/L	-	-	<0.000010	<0.000010	<0.000010
Thorium (Th)-Total	mg/L	-	-	<0.00010	<0.00010	<0.00010
Tin (Sn)-Total	mg/L	-	-	<0.00010	<0.00010	<0.00010

Federal Guidelines for Canadian Drinking Water Quality (MAR, 2019)

#1: GCDWQ - Aesthetic Objective/Other Value

#2: GCDWQ - Maximum Acceptable Concentrations (MACs)

 Detection Limit for result exceeds Guide Limit. Assessment against Guide Limit cannot be made.
 Analytical result for this parameter exceeds Guide Limit listed on this report.

* Please refer to the Reference Information section for an explanation of any qualifiers noted.

ANALYTICAL REPORT

L2376605 CONTD...
PAGE 4 of 7
19-NOV-19 07:00 (MT)

Total Metals (WATER)

		ALS ID		L2376605-1	L2376605-2	L2376605-3
		Sampled Date		31-OCT-19	31-OCT-19	31-OCT-19
		Sampled Time		15:00	15:15	14:30
		Sample ID				
Analyte	Unit	Guide Limit #1	Guide Limit #2	SOUTH CENTRAL REGIONAL 1 - RAW	SOUTH CENTRAL REGIONAL 2 - TREATED	SOUTH CENTRAL REGIONAL 3 - DISTRIBUTION
Titanium (Ti)-Total	mg/L	-	-	<0.00030	<0.00030	<0.00030
Tungsten (W)-Total	mg/L	-	-	<0.00010	<0.00010	<0.00010
Uranium (U)-Total	mg/L	-	0.02	0.00166	0.000423	0.000426
Vanadium (V)-Total	mg/L	-	-	<0.00050	<0.00050	<0.00050
Zinc (Zn)-Total	mg/L	5	-	<0.0030	<0.0030	0.0080
Zirconium (Zr)-Total	mg/L	-	-	<0.00020	<0.00020	<0.00020

Federal Guidelines for Canadian Drinking Water Quality (MAR, 2019)

#1: GCDWQ - Aesthetic Objective/Other Value

#2: GCDWQ - Maximum Acceptable Concentrations (MACs)

Volatile Organic Compounds (WATER)

		ALS ID		L2376605-1
		Sampled Date		31-OCT-19
		Sampled Time		15:00
		Sample ID		
Analyte	Unit	Guide Limit #1	Guide Limit #2	SOUTH CENTRAL REGIONAL 1 - RAW
Benzene	mg/L	-	0.005	<0.00050
1,1-dichloroethene	mg/L	-	0.014	<0.00050
Dichloromethane	mg/L	-	0.05	<0.00050
Ethylbenzene	mg/L	0.0016	0.14	<0.00050
MTBE	mg/L	0.015	-	<0.00050
Tetrachloroethene	mg/L	-	0.01	<0.00050
Toluene	mg/L	0.024	0.06	<0.00050
Trichloroethene	mg/L	-	0.005	<0.00050
o-Xylene	mg/L	-	-	<0.00050
m+p-Xylenes	mg/L	-	-	<0.00040
Xylenes (Total)	mg/L	0.02	0.09	<0.00064
Surrogate: 4-Bromofluorobenzene (SS)	%	-	-	81.3
Surrogate: 1,4-Difluorobenzene (SS) %		-	-	94.9

Federal Guidelines for Canadian Drinking Water Quality (MAR, 2019)

#1: GCDWQ - Aesthetic Objective/Other Value

#2: GCDWQ - Maximum Acceptable Concentrations (MACs)


 Detection Limit for result exceeds Guide Limit. Assessment against Guide Limit cannot be made.
 Analytical result for this parameter exceeds Guide Limit listed on this report.

* Please refer to the Reference Information section for an explanation of any qualifiers noted.

Appendix B

Water Treatment Plant Process Diagram

Process Schematic – Membrane Filtration

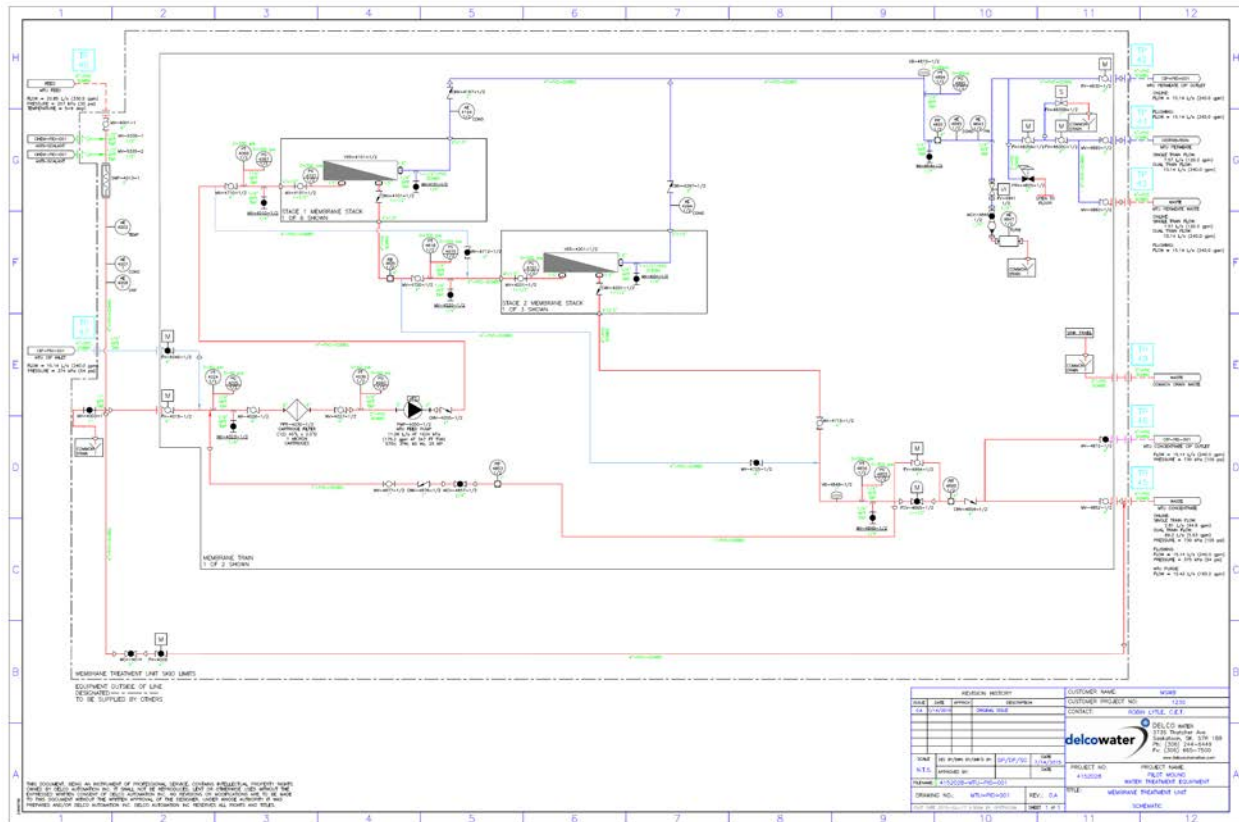

Process Schematic – Green Sand Filtration

